
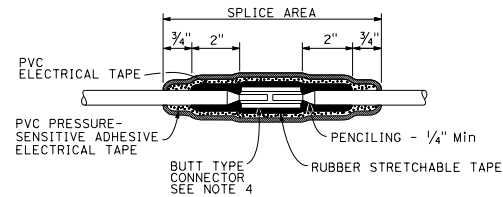
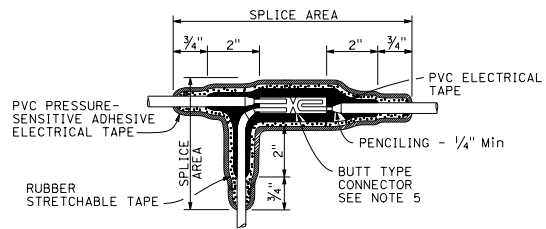
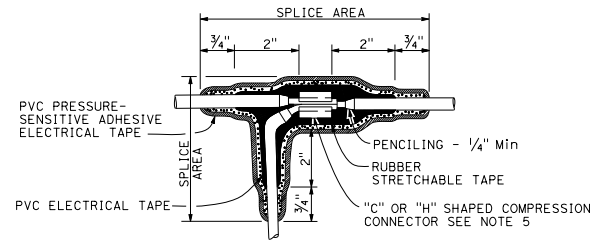


DIST	COUNTY	ROUTE	POST MILES TOTAL PROJECT	SHEET NO.	TOTAL SHEETS

*H. R. F.*  
 REGISTERED ELECTRICAL ENGINEER  
 Hamid Zolfaghari  
 No. E15636  
 Exp. 12-31-17  
 PROFESSIONAL ENGINEER  
 STATE OF CALIFORNIA

July 21, 2017  
 PLANS APPROVAL DATE  
 THE STATE OF CALIFORNIA OR ITS OFFICERS  
 OR AGENTS SHALL NOT BE RESPONSIBLE FOR  
 THE ACCURACY OR COMPLETENESS OF SCANNED  
 COPIES OF THIS PLAN SHEET.




TO ACCOMPANY PLANS DATED \_\_\_\_\_

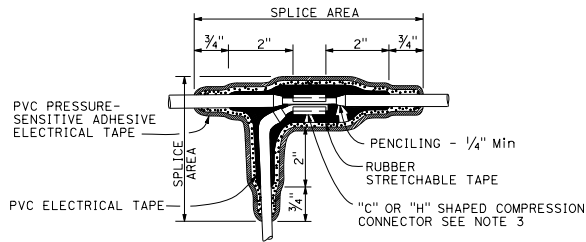

**NOTES:**

1. Dimensions are minimum.
2. Rubber tapes shall be rolled after application.
3. Between 1 free-end and 1 through conductor.
4. Between 2 free-end conductors.
5. Between 3 free-end conductors.

**TYPICAL SPLICE INSULATION METHOD B**

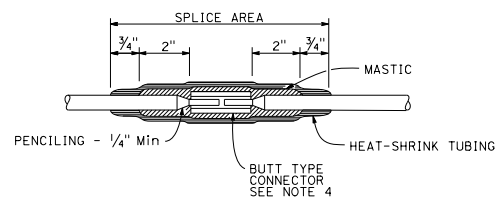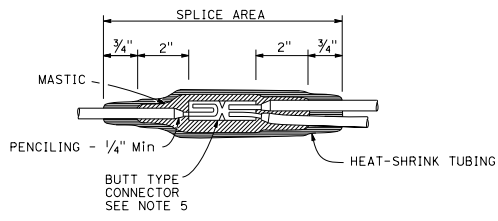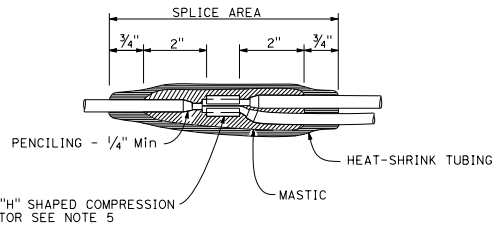

**TYPICAL SPLICE INSULATION HEAT-SHRINK TUBING**

STATE OF CALIFORNIA  
 DEPARTMENT OF TRANSPORTATION  
**ELECTRICAL SYSTEMS**  
**(SPLICE INSULATION METHODS DETAILS)**

NO SCALE

RSP ES-13A DATED JULY 21, 2017 SUPERSEDES RSP ES-13A DATED APRIL 15, 2016 AND STANDARD PLAN ES-13A DATED OCTOBER 30, 2015 - PAGE 484 OF THE STANDARD PLANS BOOK DATED 2015.

**REVISED STANDARD PLAN RSP ES-13A**

2015 REVISED STANDARD PLAN RSP ES-13A